



CAISO proposal system load and resource adequacy requirements

CPUC Workshop to Discuss Resource Adequacy Proposals

Delphine Hou

Manager, State Regulatory Affairs


February 23, 2018

ISO PUBLIC

CAISO proposes CPUC to consider 1-in-5 peak demand for shoulder months for RA planning purposes

- Based on preliminary CAISO analysis, shoulder months such as May and June experience more weather variability.
 - *E.g.*, May 3, 2017
- The larger variability in demand above 1-in-2 peak levels results in a smaller portion of the 15 percent planning reserve margin being available for unplanned resource outages and other operational issues occurring during May and June.
- CAISO to conduct analysis on all months.

Above normal weather peak demand to percentage above 1-in-2 peak demand

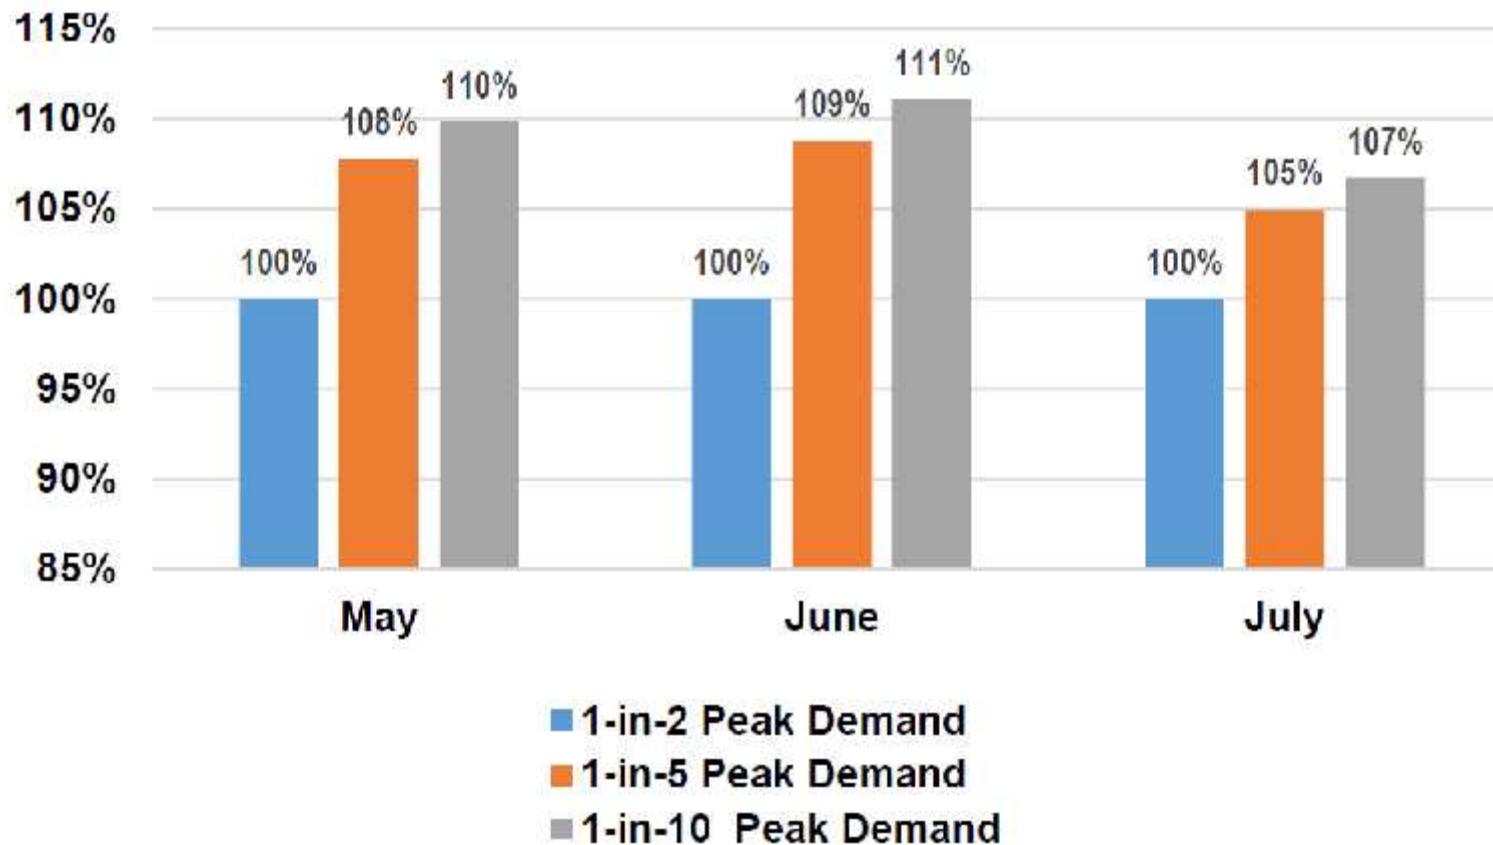

THANK YOU

Stay connected



@California_ISO



Download ISO Today
mobile app



Sign up for the
Daily Briefing at
www.caiso.com